

# DC HIGH VOLTAGE RELAY

"200" SERIES






#### Features:


- ◆ The Contact Rating: 12~900VDC
- Switching Current: 200A
- Contact and Coil Instantaneous Voltage: Up to 3KV
- Built in Energy Saving Coil to Reduce Coil Holding Power.
- Permanent Magnet Transverse Magnetic Field, Realization HV DC cut-off.
- Small Size, Light Weight.

P.O. Box 1089, 308 Components Drive, Smithfield, North Carolina 27577

Phone: 800-876-3135 Fax: 919-934-3298

E-mail: Shallco@shallco.com Website: www.shallco.com

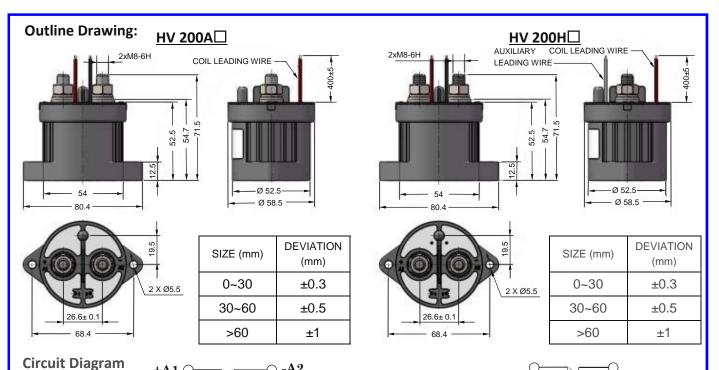



### **Performance Parameters:**

Parameter		Unit	Value	
Main contact form		1	Normally open	
Rated operating voltage		VDC	12~900	
Rated control capacity		1	200A 450V (DC-1)	
Rated short-time withstand current and duration		1	300A 900s	
			400A 200s	
Contact voltage drop		mV	≤8 <u>0@</u> 200A	
Close (includes bounce)		ms	25 Max.	
Release time		ms	12 Max.	
Contact bounce time		ms	6 Max.	
Load life		times	See load life diagram	
Mechanical life		times	1,000,000	
Auxiliary contact	Contact form	/	Normally open	
	Rated contact voltage	1	2A/24VDC、3A/125VAC	
	Min contact load	/	100mA/8V	
Insulation resistance		МΩ	100 (at 500VDC)	
Dielectric withstanding voltage		VAC	2500VAC 50 Hz/60 Hz (1 minute) 600VAC 50Hz/60Hz (1 minute) (auxiliary contact)	
Operating temperature		°C	-40∼+85	
Operating humidity		/	5%~90%	
Shock, 11ms, 1/2 Sine wave, peak value		G	20	
Vibration, Sine wave, 80~2000Hz, peak value		G	20	
Rated working form		1	Uninterrupted	
Weight (Approx.)		g	380	
Installing mode		/	Any	

#### **Coil Parameters:**

Coil operating voltage (VDC)	12	24
Coil Voltage. (Max) (VDC)	36	36
Inrush current (Max.) (A)	3.8	3.8
Inrush time (Max.) (ms)	110	110
Holding current (Avg.) A.	0.27	0.13
Max pull-in voltage (VDC)	9	9
Min drop-out voltage (VDC)	6	6

## **Estimated Make &Break Power Switching Ratings**

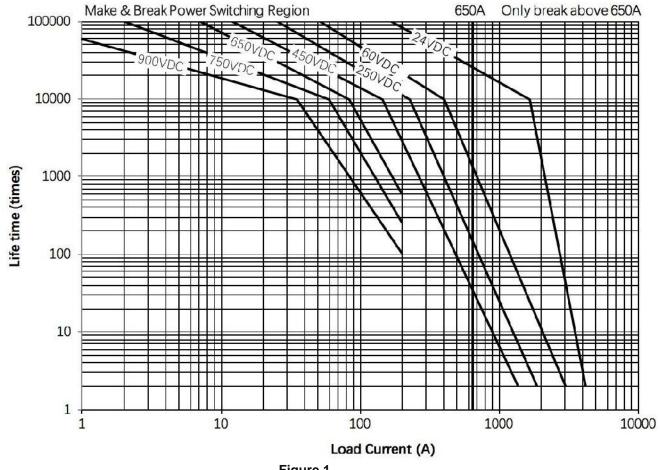


Figure 1

#### Notes:

- 1. The rated life of the product is based on a resistive load test. The maximum inductance of the load is not more than 300µH; Contact us for more information about Inductive load.
- 2. The above figure is based on estimated test and inferred data. We advise product to be tested according to the actual use.
- 3. Contact terminal force (M8): 8 ~ 10 N.m
- 4. Installation torque: 1.7 ~ 3.5 N.m

#### ORDERING INFORMATION:

HV 200 🗆 🗆 🗆 🗆

- 1 2 3 4 5 6 7
- 1 Series Designation
- (2) Rated Operating Current: "200" = 200A
- (3) "A" One set Normally Open; "H" One set Normally open with Auxiliary Contact
- Rated Coil Voltage: "A" = 11 ~ 32VDC;
- (5) Terminal Connect Method: "-": Stud Type; "B": Screw Type
- (6) Installation Mode Base Install
- (7) Customization Code: 01~99

Example: "HV200HA" means: High Voltage DC Relay, rated current under load 200A (Resistance), one set normally open (Stud Type) with Auxiliary Contact, coil voltage is (11 ~ 32) VDC, base install.





Established 1967

## CERTIFICATE TO THE STATE OF THE



This is to certify that

#### Shallco Inc

308 Components Drive Smithfield, NC 27577

has implemented and maintains a Quality Management System

#### Surpe

Straige. The design, manufacture and distribution of standard and cuctom, manually operated retary switches, electrically operated rotary switches, lock out relays, speed controllers, rotary sudiastanuators. Automotive style switches - including El-Stable relays, Mono-Stable relays and Battery Disconnact evidorics.

Through a raudit, cocumented in a report, it was verified that the management system tutils the requirements of the following standard:

ISO 9001: 2008

Certificate registration no. 10001872 GM0 Date of original certification 2003-09-06

Date of certification 2015 09 08 Valid until 2018-09-07



UL DQS Inc.

□Net



According Rody III DCS no., 1130 West Lake ConcRost Rute 340, 3 dfain Grove, II 60075 USA